


# GROUND LEVEL EQUIPMENT CLEARANCE FROM CONNEXUS ENERGY POLE

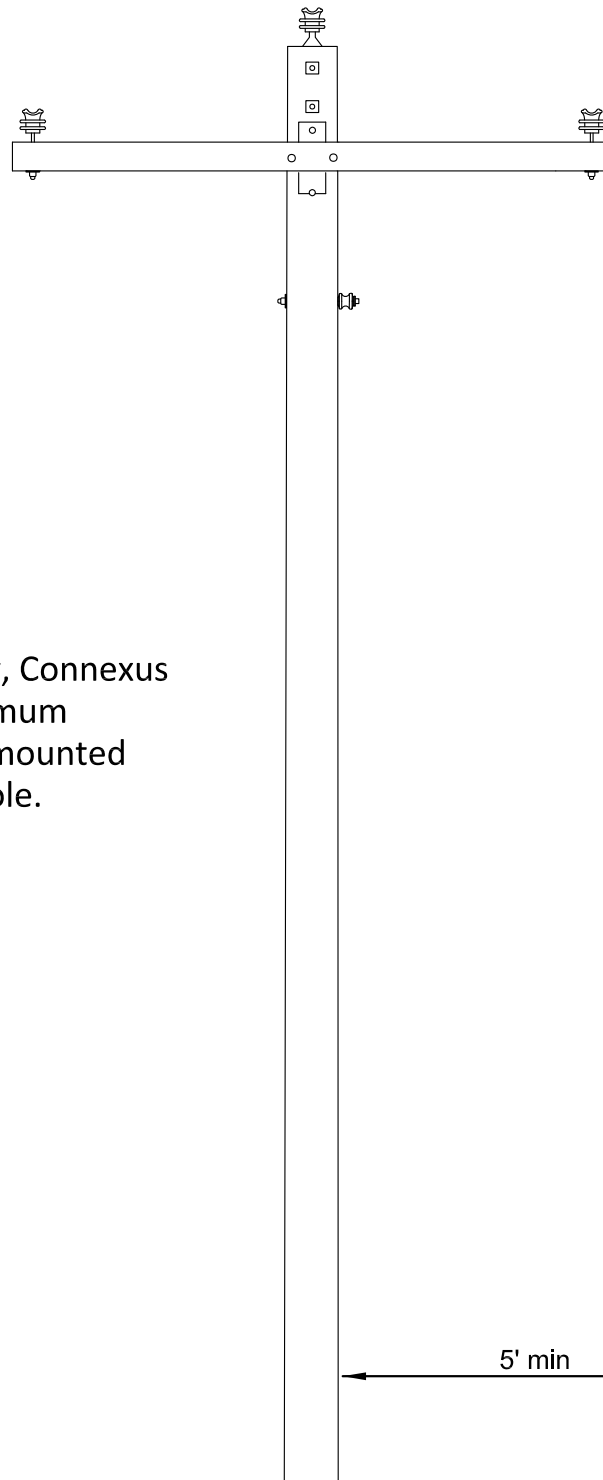

- For personnel safety, Connexus requires 5 feet minimum clearance from padmounted equipment to the pole.

PADMOUNTED  
EQUIPMENT

5' min